


- ITEM NO. AND DESCRIPTION:
- 1 ULTRASONIC METER.
  - 2 STRAINER.
  - 3 GATE VALVE.
  - 4 DRAIN ROCK: TOPPED WITH 4" OF 3/4 CRUSHED.
  - 5 5x7 CONCRETE VAULT WITH BILCO STYLE TYPE "K" ALUMINUM DOOR.
  - 6 UNION COUPLER.
  - 7 ALPHA ROMAGRIP JOINT
  - 8 2" BYPASS OCTIVE METER.

- NOTES:
1. SUPPORT METER AND PIPE WITH APPROVED PIPE SUPPORT STANDS AND PROVIDE 12" CLEARANCE FROM THE FLOOR.
  2. BILCO STYLE TYPE "K" ALUMINUM DOOR.
  3. OPEN BOTTOM WITH DRAIN ROCK.
  4. MEET HUD STANDARDS OR ISPCW STANDARDS FOR ALL COMPONENTS. IN THE CASE OF CONFLICT, THE MOST STRINGENT WILL APPLY.
  5. COORDINATE INSIDE DIMENSIONS OF STRUCTURE TO ALLOW FOR PIPING LAYOUT AS SHOWN AND DETERMINE THE ACTUAL LENGTHS OF DUCTILE IRON.
  6. CENTERLINE OF PIPING SHALL BE 36" ABOVE FLOOR GRADE.



REVISIONS	
DATE	DESCRIPTION

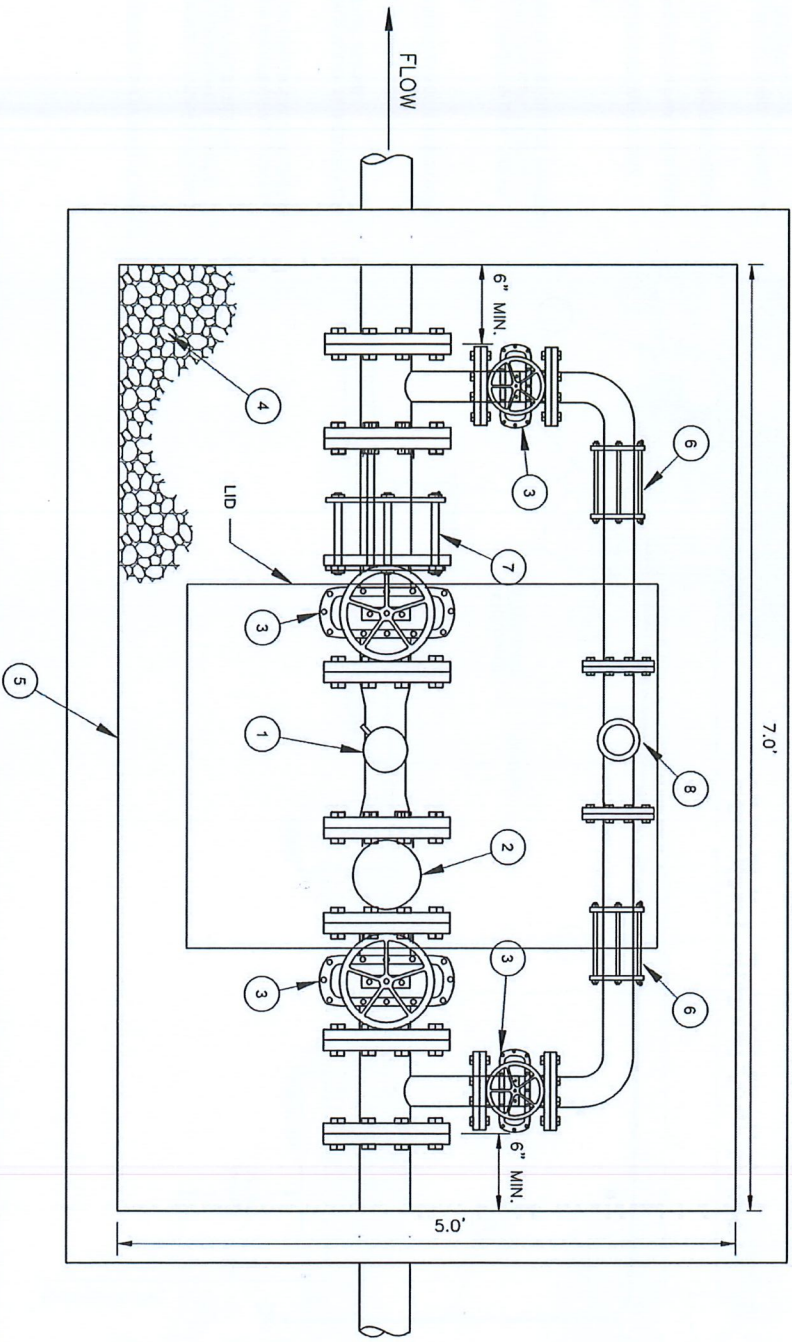

HAYDEN LAKE  
IRRIGATION DISTRICT

TYPICAL 3" AND LARGER METER SET

SCALE: NONE  
DWG: 008 - 3IN AND LARGER METER SET(11-2019).dwg

DATE: April, 2020  
APPROVED: BR

HLID DETAIL #:  
008